


DAHLBERG LIGHT AND POWER CO.
RESIDENTIAL OVER HEAD SERVICE
SERVICE ENTRANCE LOCATED ON A BUILDING
GUIDELINE ONLY

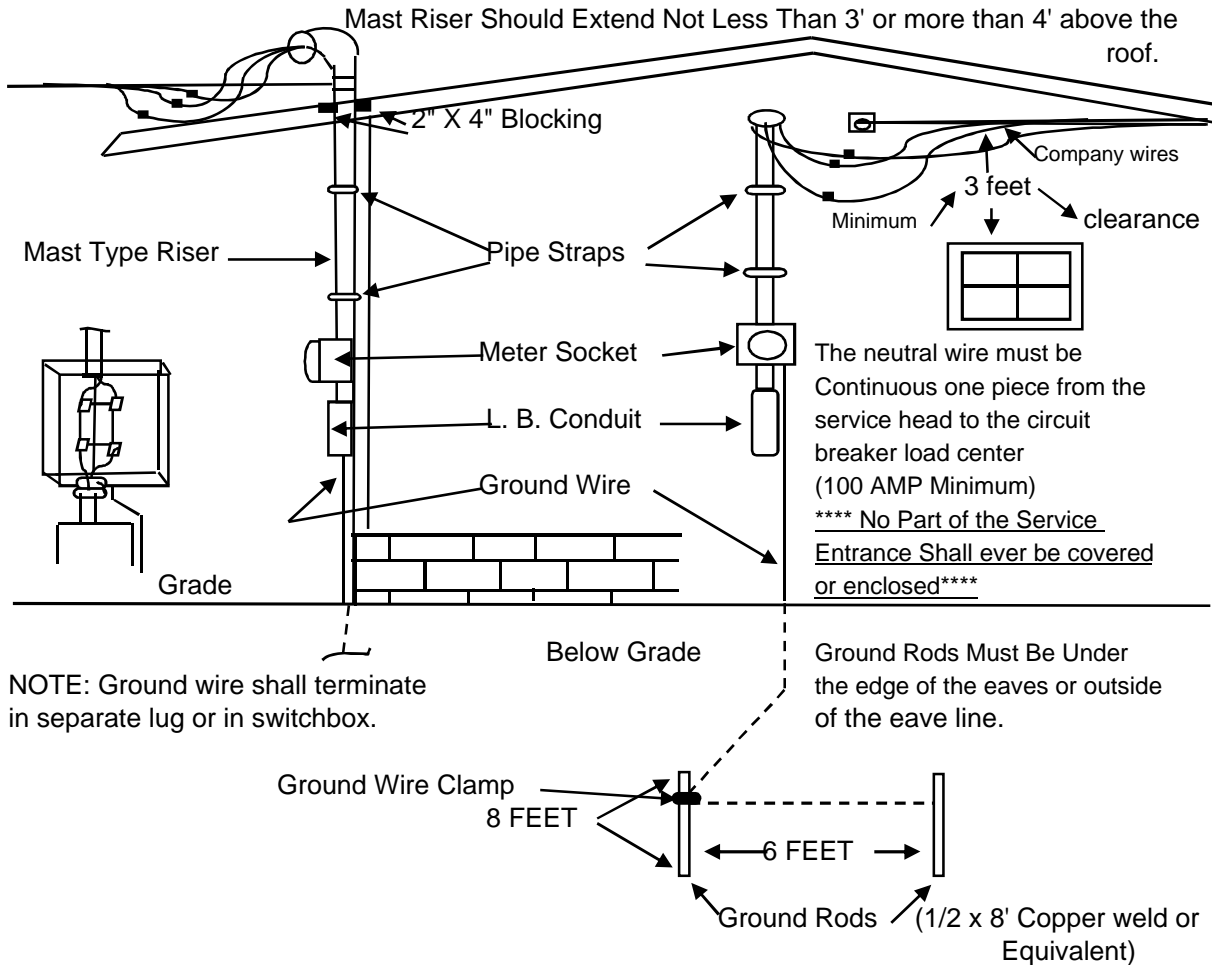

THE OVERHEAD MAST SHALL BE 2" I. D. HEAVY WALL METAL CONDUIT. THE SERVICE HEAD SHALL BE ABOVE THE ROOF AND BE AT LEAST 12 FEET ABOVE THE FINISHED GRADE. IF THE MAST DOES NOT EXTEND THROUGH THE ROOF, SCHEDULE 80 ELECTRIC PVC MAY BE USED.

THE SERVICE ENTRANCE CIRCUIT BREAKER ENCLOSURE IS TO BE LOCATED AT THE POINT WHERE THE SERVICE ENTRANCE CONDUCTORS ENTER THE BUILDING AND IT MUST BE DEAD-FRONT AND 100 AMP MINIMUM.

A MINIMUM OF 2' LEAD WIRE MUST BE LEFT COMING OUT OF THE MAST HEAD FOR THE COMPANY TO CONNECT ITS WIRES.

METER SOCKET HEIGHT:--- MEASURED FROM FINISHED GRADE TO CENTER OF SOCKET
MAXIMUM HEIGHT: 6 FEET
MINIMUM HEIGHT: 4 FEET, 6 INCHES

This sheet sets forth the company specifications for your service entrance. Any modification from what is shown on this sheet shall be discussed with a representative of the company prior to your construction of your service.