


DAHLBERG LIGHT AND POWER  
RESIDENTIAL UNDERGROUND SERVICE  
SERVICE ENTRANCE LOCATED ON A BUILDING  
GUIDELINE ONLY

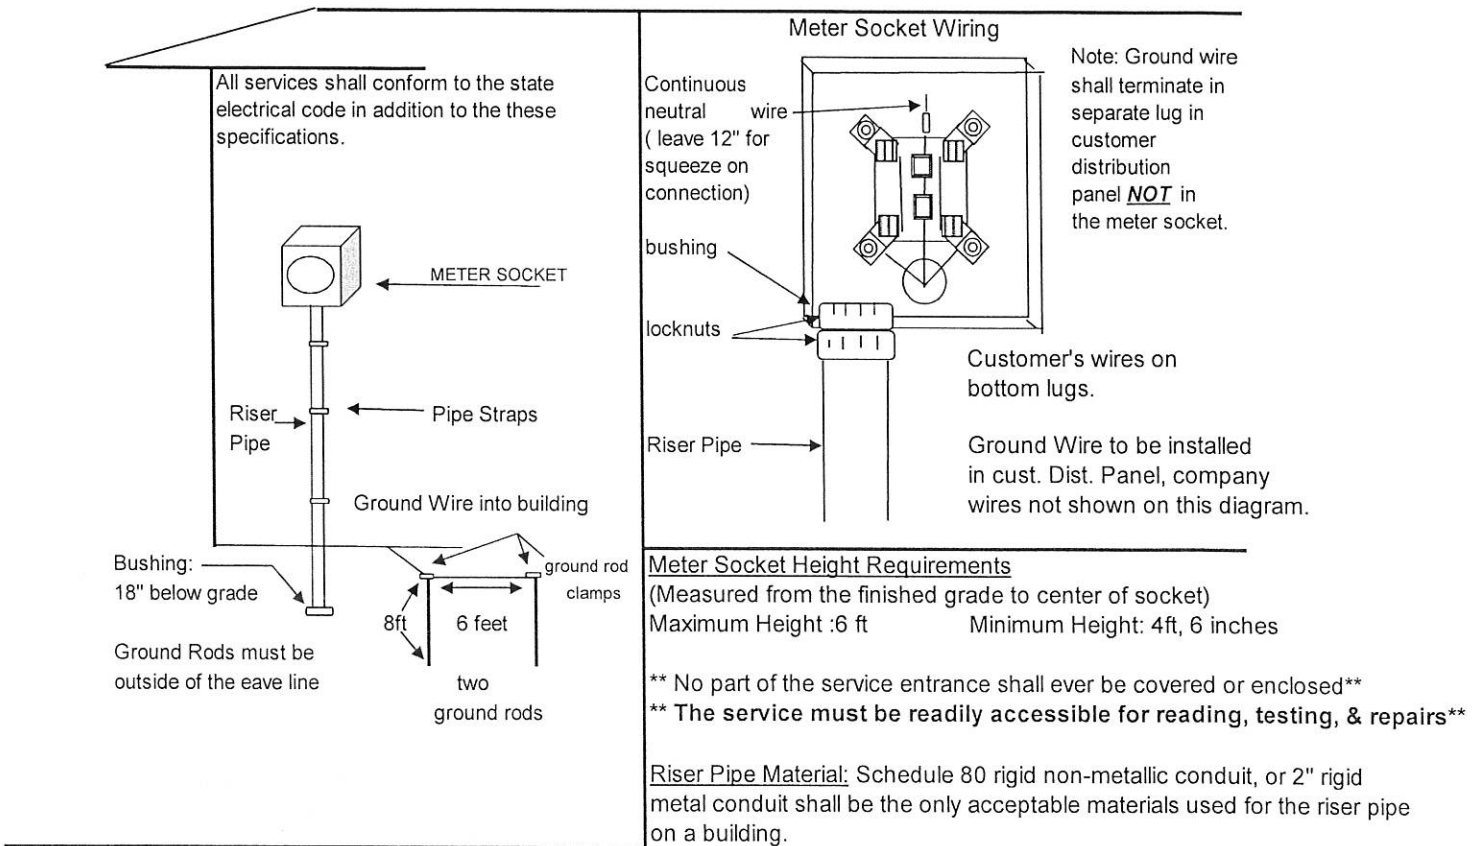

UNDERGROUND SERVICE METER SOCKET MINIMUM SIZE DIMENSION:  
200 AMP: 14' X 12" X 4 3/8" SOCKET MUST BE RATED AT 200 AMPS.

NOTE: METER SOCKETS SHALL MEET THE MINIMUM SIZE DIMENSIONS INDICATED ABOVE UNLESS OTHERWISE APPROVED BY THE COMPANY PRIOR TO CONSTRUCTION OF THE SERVICE ENTRANCE.

**\*\*\* THE SERVICE ENTRANCE CIRCUIT BREAKER ENCLOSURE IS TO BE LOCATED AT THE POINT WHERE THE SERVICE ENTRANCE CONDUCTORS ENTER THE BUILDING AND IT MUST BE DEAD FRONT AND 200 AMP MINIMUM. \*\*\***

This sheet sets forth the company specifications for your service entrance. Any modification from what is shown on this sheet shall be discussed with a representative of the company prior to your construction of your service.